


Soft

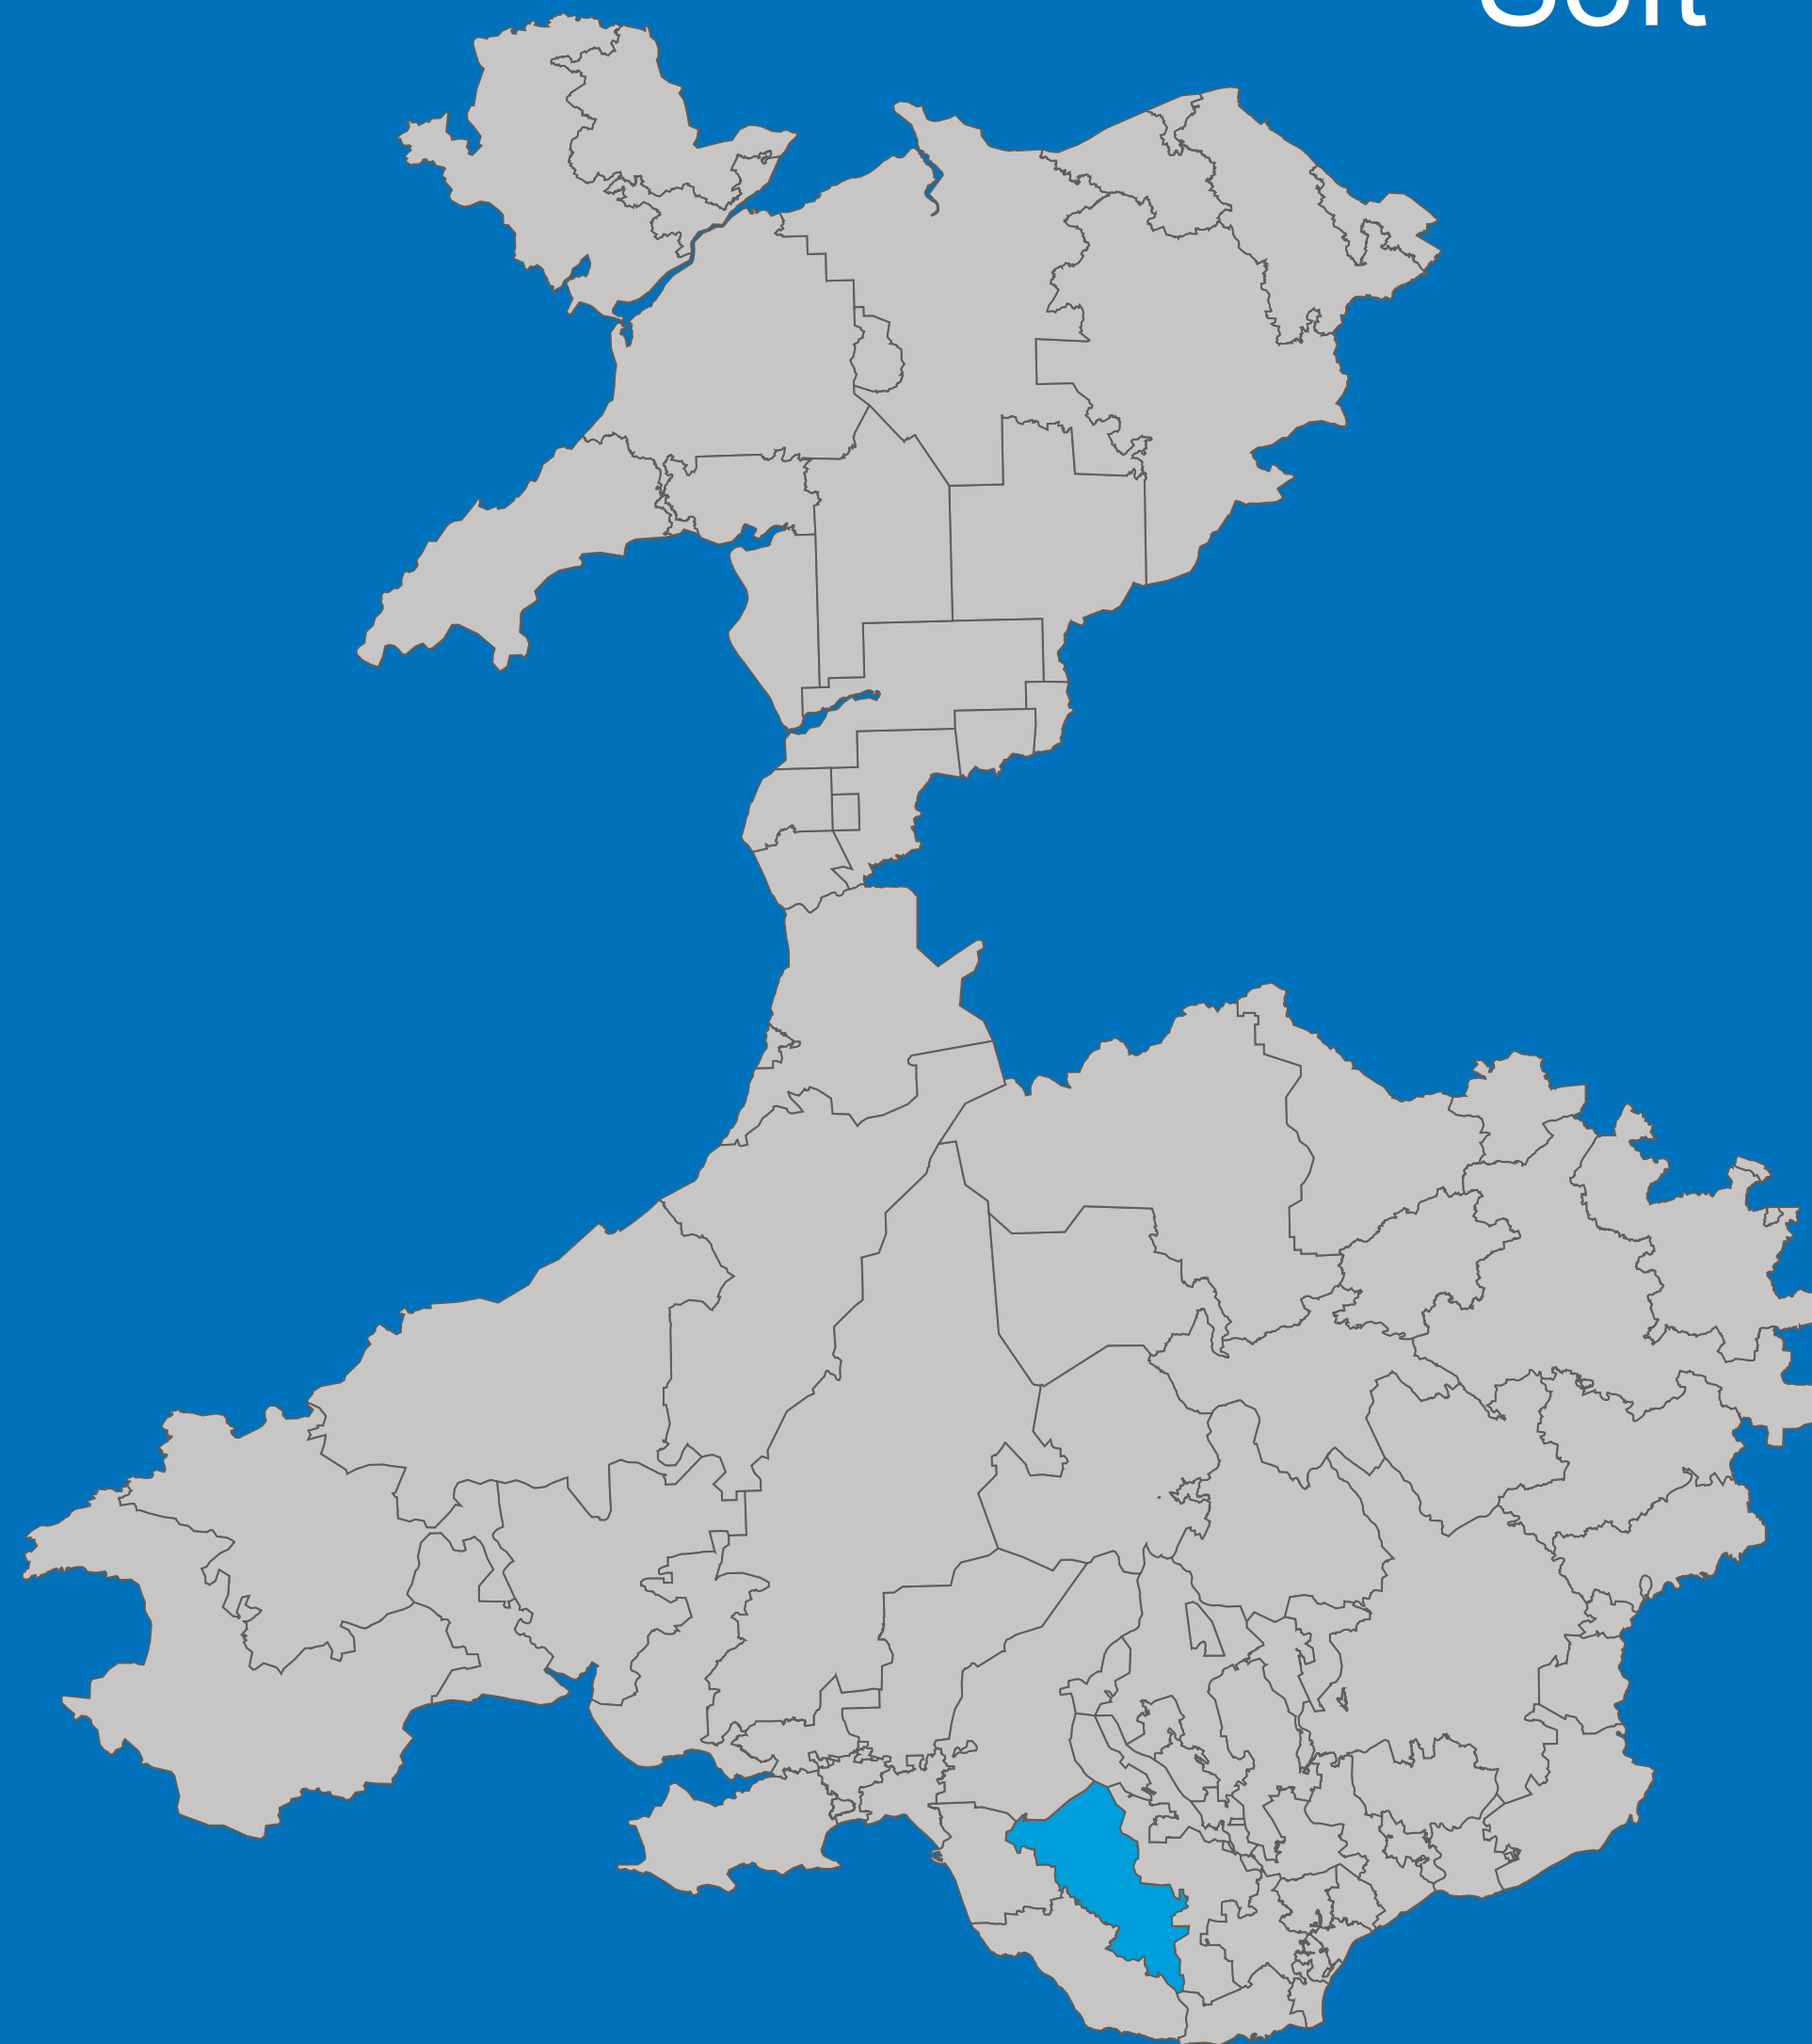

7.56	23.84	29.09
pH	Alkalinity [pH 4.5] (mg/l as CaCO3)	Bicarbonate (mg/l)
15.66	1.35	89.46
Calcium (mg/l)	Magnesium (mg/l)	Conductivity [20°C] (µS/cm)
41.17	37.45	9.10
Hardness [Total] (mg/l)	Hardness [Calcium] (mg/l)	Hardness [Magnesium] (mg/l)
2.88	4.12	2.31
Hardness [Clarke] (°eH)	Hardness [French] (°fH)	Hardness [German] (°dH)
8.86	13.44	8.38
Chloride [Ion] (mg/l)	Sulphate (mg/l)	Sodium (mg/l)

2018	2020	2022
2019	2021	2023

Dŵr Cymru Welsh Water do not dose chloramine or fluoride at any part of the treatment process